

# G3PC

Refer to *Safety Precautions for All Solid State Relays*.

**Detects failures in SSR used for heater temperature control and simultaneously outputs alarm signal. This SSR supports the safe design of heater control systems, and contributes to maintenance improvements by the user.**

- Main detection items:  
SSR short-circuits and SSR open-circuits
- Alarm output possible to NPN/PNP-input devices.
- The failure-detection function is built-in and power is supplied from the main circuit power supply making wiring simple.
- Slim design (width: 22.5 mm) incorporating a heat sink.
- In addition to screw mounting, DIN track mounting is also possible.
- Certified by EC, UL, and CSA.



## Model Number Structure

### Model Number Legend

**G3PC-**□□□□-□  
1 2 3 4 5

#### 1. Basic Model Name

G3PC: SSR with Failure Detection Function

#### 2. Rated Load Power Supply Voltage

2: 100 to 240 VAC

#### 3. Rated Load Current

20: 20 A (carry current)

#### 4. Terminal Type

B: Screw terminals

#### 5. Certification

VD: Certified by UL, CSA, and VDE

## Ordering Information

### List of Models

Insulation method	Zero cross function	Indicators	Rated output load	Model number
Phototriac coupler	Yes	Yes (See page 5)	20 A, 100 to 240 VAC (resistive load: AC, Class1)	G3PC-220B-VD

**Note:** When ordering, specify the rated input voltage.

### Accessories (Order Separately)

Name	Dimensions	Model number
Mounting Track	50 cm (l) × 7.3 mm (t)	PPF-50N
	1 m (l) × 7.3 mm (t)	PPF-100N
	1 m (l) × 16 mm (t)	PPF-100N2

# Specifications

## ■ Ratings (at an Ambient Temperature of 25°C)

### Detection Power Supply

Rated power supply voltage	100 to 240 VAC (50/60 Hz)
Operating voltage range	75 to 264 VAC (50/60 Hz)
Current consumption	15 mA AC max. (at 200 VAC)

### Operating Circuit

Input method	Voltage input
Rated input voltage	12 to 24 VDC
Operating input voltage range	9.6 to 30 VDC
Must operate voltage	9.6 VDC max.
Must release voltage	1 VDC min.
Input current	7 mA DC max. (at rated input voltage)

### Main Circuit

Rated load voltage	100 to 240 VAC (50/60 Hz)
Operating voltage range	75 to 264 VDC (50/60 Hz)
Applicable load current	20 A (Ta = 40)
Minimum load current	0.1 A
Inrush current resistance (peak value)	220 A (60 Hz, 1 cycle)
Permissible (I <sup>2</sup> t)	260 A <sup>2</sup> s
Applicable load (with Class-1 AC resistive load)	4 kW (at 200 VAC)

### Alarm Output


Output OFF collector voltage	30 VDC max.
Maximum carry current	0.1 A
Output form	Independent NPN open collector

## ■ Characteristics


<b>Operate time</b>	1/2 of load power source cycle + 1 ms max.	
<b>Release time</b>	1/2 of load power source cycle + 1 ms max.	
<b>Main circuit</b>	<b>Output ON voltage drop</b>	1.6 V rms max.
	<b>OFF leakage current</b>	10 mA max. (at 200 VAC)
<b>Alarm output</b>	<b>Output ON voltage drop</b>	1.5 V max.
	<b>OFF leakage current</b>	0.1 mA max.
<b>Insulation resistance</b>	100 MΩ min. (at 500 VDC)	
<b>Dielectric strength</b>	2,500 VAC, 50/60 Hz for 1 min	
<b>Vibration resistance</b>	Destruction: 10 to 55 to 10 Hz, 0.35-mm single amplitude	
<b>Shock resistance</b>	Destruction: 294 m/s <sup>2</sup>	
<b>Ambient temperature</b>	Operating: -20 to 60°C (with no icing or condensation) Storage: -30 to 70°C (with no icing or condensation)	
<b>Ambient humidity</b>	45% to 85%	
<b>Weight</b>	Approx. 300 g	
<b>Certified standards</b>	UL508, CSA22.2 No. 14, EN60947-4-3 (IEC947-4-3); Certified by VDE	
<b>EMC</b>	Emission: EN55011 Group 1 Class B Immunity: EN61000-6-2	

## Engineering Data

### Input Voltage vs. Input Current Input Voltage vs. Input Impedance

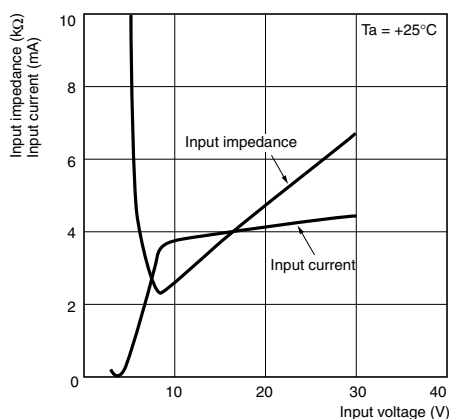


### Load Current vs. Ambient Temperature

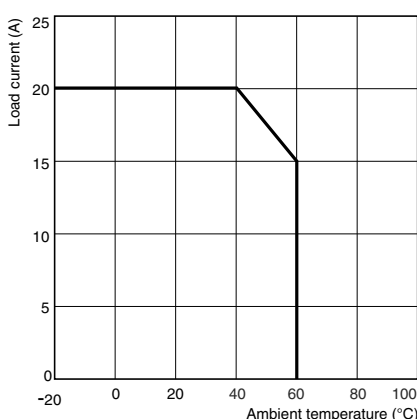

### One Cycle Surge Current: Non-repetitive

The figure will be less than 1/2 the rated value for repetitive input.

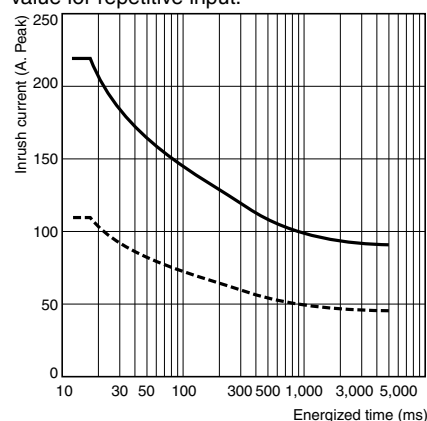

# Operation

## ■ Failure Detection Function

### Conditions for SSR Failure Detection

Failure mode (See note 1.)	Operating input (between terminals A1 and A2)	Detection time	Alarm display (See note 3.)	Alarm display (between terminals X1 and X2) (See note 3.)
SSR short-circuit	OFF	0.5 s max. (See note 2.)	Red	Open collector transistor output
SSR half-wave short-circuit	OFF			
SSR open-circuit	ON			
SSR half-wave open-circuit	ON			

**Note: 1.** The contents of each of the above failure modes is as follows:

SSR short-circuit: SSR output circuit remains in the ON state.

SSR half-wave short-circuit: SSR output circuit remains in the ON state in one direction.

SSR open-circuit: SSR output circuit remains in the OFF state.

SSR half-wave open-circuit: SSR output circuit remains in the OFF state in one direction.


In addition to the failure modes listed above, detection of circuit disconnections for the load circuit is also possible. (As a rough guide, circuit disconnection will be detected if the load impedance is greater than or equal to 1 M $\Omega$ )

- The same power supply is used for both the detection and for the output circuit and so detection is not performed during power interruptions.
- If power supply (terminal 3) is in the open state, the SSR will still turn ON and OFF in the same way but the failure detection function and alarm display will not operate properly.


### Connection Diagrams (Main Circuit)

The following diagrams show the applicable load connection configurations for SSR failure detection.


#### Single Phase

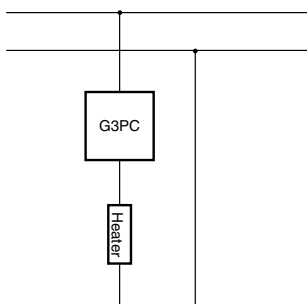


#### 3-phase Star Connection

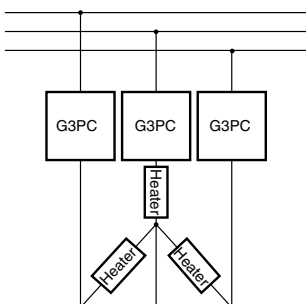

#### 3-phase Delta Connection (3-phase, 2-wire Switching)

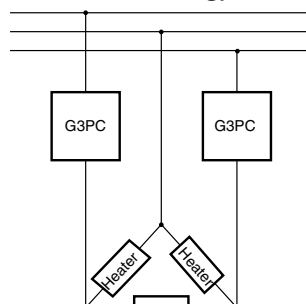


#### 3-phase V Connection

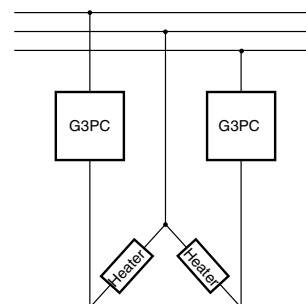

**Note:** With 3-phase connection, so that the power supply voltage is applied between the G3PC's terminals 1/L1 and 3, connect the desired phase to terminal 3.


### Timing Chart

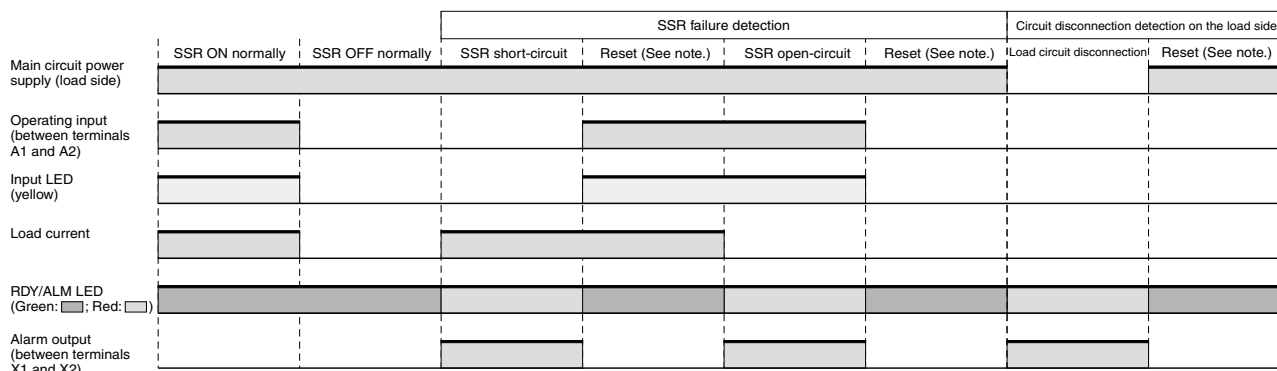

**Note:** After failure detection, if the detection conditions differ to the conditions given under *Conditions for SSR Failure Detection*, alarm output is reset.

# Dimensions

## G3PC-220B-VD


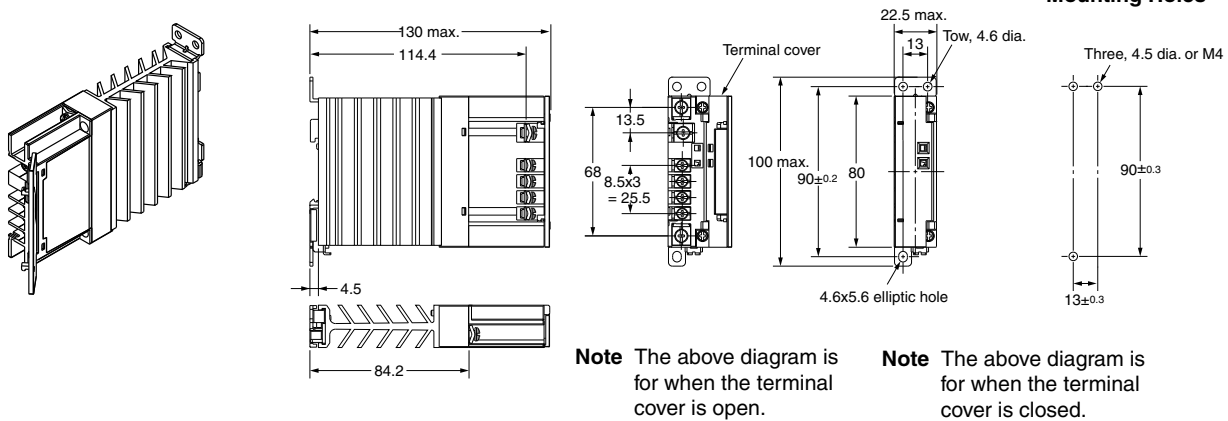


## Accessories (Order Separately)

### Mounting Tracks

PFP-100N, PFP-50N

PFP-100N2

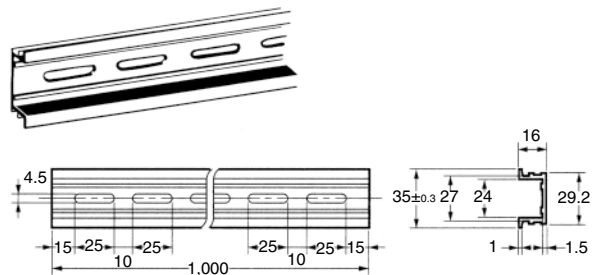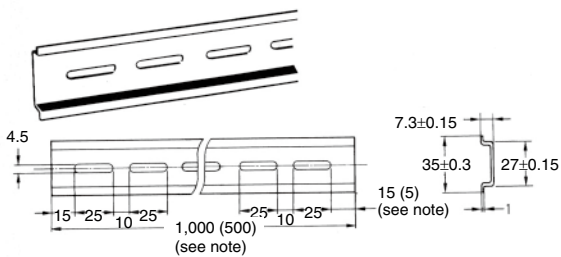

**Note** Values in parentheses indicate dimensions for the PFP-50N.

# Installation

## External Specifications

### Terminal Arrangement


Terminal name	Terminal number	Screw size
Main circuit terminals (output)	1/L1, 2/T1	M4
Detection power supply terminal (input)	3	
Operating circuit terminals (input)	A1, A2	M3.5
Alarm output terminals (output)	X1, X2	

### Indicators


Name	Symbol	Color	Meaning
Status indicators	RDY	Green	SSR normal
	ALM	Red	SSR failure detection and circuit disconnection detection
Input indicator	INPUT	Yellow	Operating

**Note:** The same indicator is used as both the power supply indicator and the alarm indicator.

## Appearance

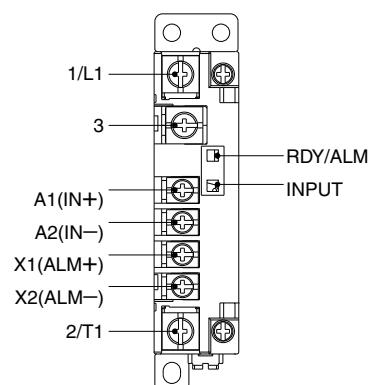

## Connection Example

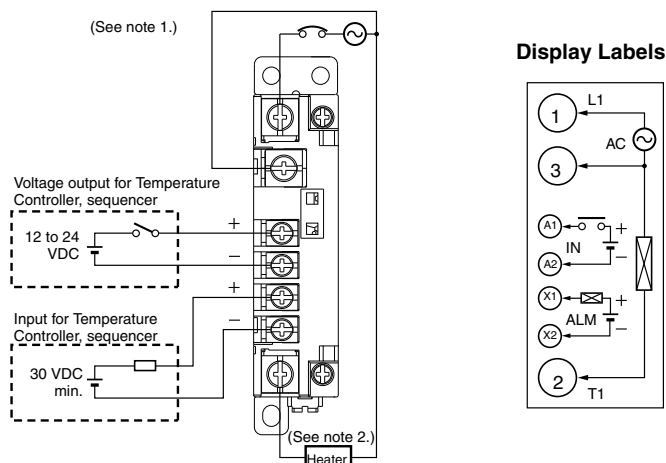

**Note:** 1. If the detection power supply terminal (terminal 3) is not connected, failure detection is not performed and so be sure to connect this terminal.

2. If the load is connected to terminal 1/L1, failure detection may not operate correctly and so connect the load to terminal 2/T1.

3. With inductive loads (relay coil, etc.), connect back-current prevention diodes to both sides of the load.

# Safety Precautions

## ■ Precautions for Correct Use

Please observe the following precautions to prevent failure to operate, malfunction, or undesirable effect on product performance.

### Mounting Method

#### DIN Track Mounting

When mounting to a DIN track, mount the G3PC until it clicks into place, otherwise it become loose during use and fall. Fix both ends with end plates.


#### Panel Mounting

When mounting directly to a panel, observe the following conditions:


Screw diameter: M4

Tightening torque: 0.98 to 1.47 N·m

#### Vertical Mounting




#### Horizontal Mounting



**Note:** Use the G3PC at a load current of 50% of the rated load current when it is mounted horizontally.

#### Close Mounting

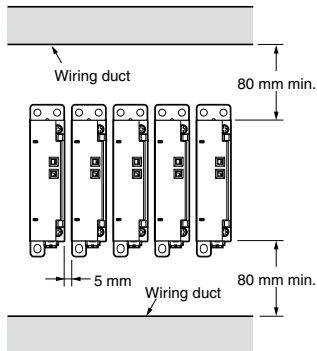


**Note:** Use the G3PC at a load current of 80% of the rated load current when it is mounted side by side.


## Wiring

- When using crimp terminals, observe the terminal clearances shown below.

#### Main Circuit Power Supply (Terminals 1 to 3)



#### Operating Input/Alarm Output (Terminals A1, A2, X1, and X2)



- Make sure that all lead wires are of a thickness appropriate for the current.
- The output terminals are charged, and touching them may result in electric shock, even when the G3PC is OFF. Separate the outputs from the power supply by installing a circuit-breaker at a higher level in the circuit.


## Tightening Torque

Be sure to tighten the screws to the specified torques given below. Not doing so may result in malfunction.

Terminal number	Screw terminal diameter	Tightening torque
A1, A2, X1, X2	M3.5	0.59 to 1.18 N·m
1/L1, 2/T1, 3	M4	0.98 to 1.47 N·m

## EMC Directive Compliance

The Unit complies with the EMC Directives in the following conditions.

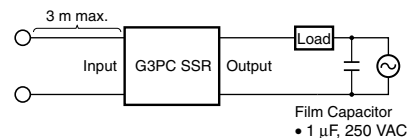

- Connect film capacitors to both sides of the load power supply output.
- The input cable must be no longer than 3m.

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.  
To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.

In the interest of product improvement, specifications are subject to change without notice.

# Safety Precautions for All Solid State Relays

Refer to the *Safety Precautions* section for each SSR for specific precautions applicable to that SSR.

## ⚠ CAUTION

Do not touch the SSR or the heat sink while the power is being supplied or immediately after the power supply has been turned OFF.  
Touching the SSR or heat sink while it is hot may result in burns.



Do not touch the LOAD terminals on the SSR immediately after the power supply has been turned OFF.  
Shock may result due to the electrical charge stored in the built-in snubber circuit.



Always attach the cover terminal if the SSR has one.  
Contact with current-carrying parts may result in shock.



Always turn OFF the power supply before performing wiring.  
Not doing so may result in shock.



Do not allow short-circuit current to flow to the load side of the SSR.  
The SSR may explode if short-circuit current flows.



## ■ Precautions for Safe Use

OMRON constantly strives to improve quality and reliability. SSRs, however, use semiconductors, and semiconductors may commonly malfunction or fail. In particular, it may not be possible to ensure safety if the SSRs are used outside the rated ranges. Therefore, always use the SSRs within the ratings. When using an SSR, always design the system to ensure safety and prevent human accidents, fires, and social harm in the event of SSR failure. System design must include measures such as system redundancy, measures to prevent fires from spreading, and designs to prevent malfunction.

1. Do not apply voltage or current in excess of the ratings to the terminals of the SSR.  
Doing so may result in failure or burn damage.
2. Do not use the SSR with loose terminal screws.  
Doing so may result in burn damage due to abnormal heat produced by the terminals.
3. Do not block the movement of the air surrounding the SSR or heat sink.  
Abnormal heating of the SSR may result in shorting failures of the elements or burn damage.
4. Follow the *Precautions for Correct Use* when performing wiring or tightening the screws.  
If the SSR is used with the wiring or screw tightening performed improperly, burn damage may occur due to abnormal heat generated when the power is being applied.

## ■ Precautions for Correct Use

For details, refer to *Technical Guide for Solid State Relays*.

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.

To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.

In the interest of product improvement, specifications are subject to change without notice.

## Read and Understand This Catalog

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

## Warranty and Limitations of Liability

### WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

### LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS, OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted.

IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

## Application Considerations

### SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of products in the customer's application or use of the product.

At the customer's request, OMRON will provide applicable third party certification documents identifying ratings and limitations of use that apply to the products. This information by itself is not sufficient for a complete determination of the suitability of the products in combination with the end product, machine, system, or other application or use.

The following are some examples of applications for which particular attention must be given. This is not intended to be an exhaustive list of all possible uses of the products, nor is it intended to imply that the uses listed may be suitable for the products:

- Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this catalog.
- Nuclear energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations.
- Systems, machines, and equipment that could present a risk to life or property.

Please know and observe all prohibitions of use applicable to the products.

NEVER USE THE PRODUCTS FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

## Disclaimers

### CHANGE IN SPECIFICATIONS

Product specifications and accessories may be changed at any time based on improvements and other reasons.

It is our practice to change model numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the product may be changed without any notice. When in doubt, special model numbers may be assigned to fix or establish key specifications for your application on your request. Please consult with your OMRON representative at any time to confirm actual specifications of purchased product.

### DIMENSIONS AND WEIGHTS

Dimensions and weights are nominal and are not to be used for manufacturing purposes, even when tolerances are shown.

### ERRORS AND OMISSIONS

The information in this catalog has been carefully checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical, or proofreading errors, or omissions.

### PERFORMANCE DATA

Performance data given in this catalog is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of OMRON's test conditions, and the users must correlate it to actual application requirements. Actual performance is subject to the OMRON Warranty and Limitations of Liability.

### PROGRAMMABLE PRODUCTS

OMRON shall not be responsible for the user's programming of a programmable product, or any consequence thereof.

### COPYRIGHT AND COPY PERMISSION

This catalog shall not be copied for sales or promotions without permission.

This catalog is protected by copyright and is intended solely for use in conjunction with the product. Please notify us before copying or reproducing this catalog in any manner, for any other purpose. If copying or transmitting this catalog to another, please copy or transmit it in its entirety.